




# OPERATION AND MAINTENANCE INSTRUCTIONS FOR Air Dryer Pirate Brand™ (ADPB)

**PACKAGED COMPRESSED AIR TREATMENT SYSTEM**

**MODELS: ADPB-400 through ADPB-1600**

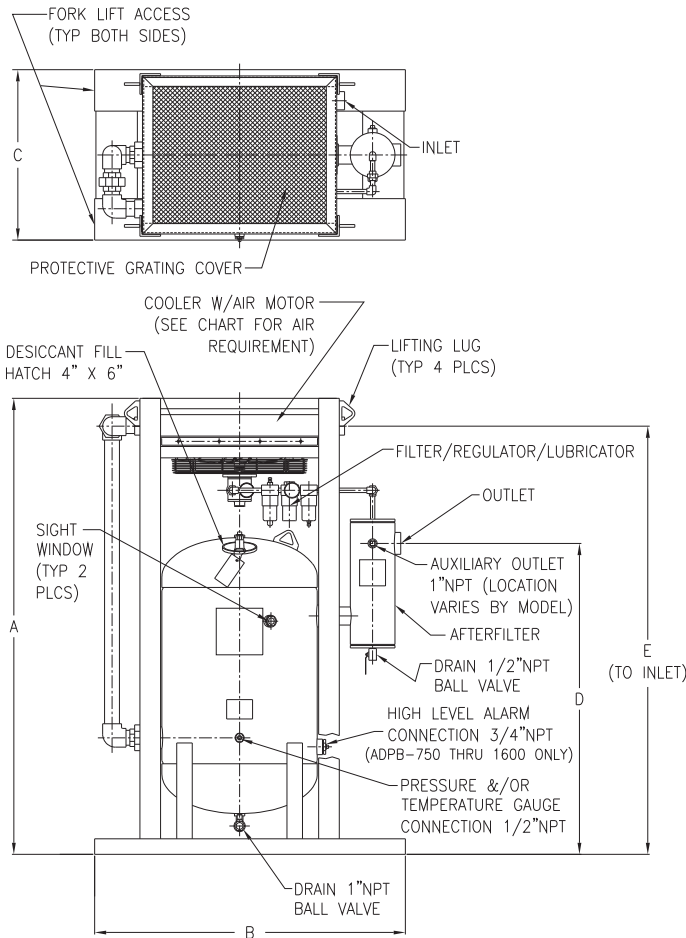

MODEL	A	B	C	D	E
ADPB-400	77"	49"	26"	58-9/16"	72-1/8"
ADPB-750-950	83-3/4"	54"	32-7/8"	59-1/2"	78-3/8"
ADPB-1200	88"	60"	32-7/8"	60"	82-5/8"
ADPB-1600	94-1/2"	71-1/2"	43"	59-1/8"	89-3/8"

MODEL	REGULATOR SETTING FOR AIR MOTOR
ADPB-400	20 PSIG TO GET 1725 RPM (25 SCFM)
ADPB-750-950	22 PSIG TO GET 1725 RPM (70 SCFM)
ADPB-1200	30 PSIG TO GET 1725 RPM (70 SCFM)
ADPB-1600	20 PSIG TO GET 1725 RPM (150 SCFM)

MODEL	INLET	OUTLET	WEIGHT	DRY-O-LITE DESICCANT *
ADPB-400	2" NPT	2" NPT	760 lbs	400 lbs
ADPB-750-950	2-1/2"NPT	2-1/2"NPT	1155 lbs	500lbs
ADPB-1200	2-1/2"NPT	3" NPT	1525 lbs	750 lbs
ADPB-1600	3" NPT	3" NPT	1875 lbs	1000 lbs

\* - ORIGINAL FILL OF DESICCANT SUPPLIED - CUSTOMER TO INSTALL

## WARNING

**DO NOT OPERATE THIS SYSTEM ABOVE MAXIMUM WORKING PRESSURE (MWP) AND/OR MAXIMUM OPERATING TEMPERATURE (°F) SHOWN ON THE VESSEL ASME DATA PLATE.**

**THIS ASME CODE VESSEL MUST BE PROTECTED BY A PRESSURE RELIEF VALVE. Refer to OSHA 1910.169 Par. b, Sub. Par (3) and ASME Boiler and Pressure Vessel Code, Section VIII, Division 1, UG-125 through UG-136. Also comply with all applicable state and local codes.**

**DO NOT ATTEMPT TO REMOVE OR REPAIR ANY PART OF THE SYSTEM UNTIL IT IS COMPLETELY DEPRESSURIZED. SERIOUS PERSONAL INJURY MAY RESULT IF THIS SAFETY RULE IS NOT FOLLOWED.**

**DO NOT WELD, GRIND, OR SAND VESSEL, THIS WILL MAKE IT UNSAFE TO OPERATE. (Note: Any alteration to the vessel will void the ASME Code Certification and the warranty.)**

**INSPECT VESSEL, INSIDE AND OUT, REGULARLY FOR BULGES, CORROSION, DENTS, GOUGES, LEAKS OR SIGNS OF FIRE. IF DAMAGED, REMOVE FROM SERVICE IMMEDIATELY AND NOTIFY YOUR CERTIFYING AUTHORITY.**

**DO NOT TRY TO TIGHTEN A LEAKING HATCH COVER. IMMEDIATELY SHUT OFF THE AIR SUPPLY AND DEPRESSURIZE THE SYSTEM.**

**DO NOT ATTEMPT TO REMOVE THE HATCH COVER UNTIL THE SYSTEM IS COMPLETELY DEPRESSURIZED. WHEN THE VESSEL PRESSURE IS REDUCED TO ZERO, THE HATCH COVER CAN BE REMOVED BY HAND.**

**INSTALL A NEW GASKET EVERY TIME THE HATCH COVER IS REMOVED, OR AT LEAST ONCE PER YEAR. INSPECT THE COVER AND SEALING SURFACE FOR DAMAGE SUCH AS CORROSION, CRACKS, OR DISTORTION. IF THERE IS ANY DAMAGE, REPLACE COVER. REPLACE THE HATCH COVER EVERY FIVE YEARS REGARDLESS OF CONDITION. USE PIRATE BRAND AUTHORIZED PARTS ONLY.**

**DO NOT USE POWER TOOLS OR CHEATER BARS TO TIGHTEN THE NUT ON THE HATCH COVER. TOO MUCH FORCE CAN DISTORT THE COVER AND/OR THE GASKET. IF DAMAGED BY OVERTIGHTENING, THE COVER CAN BLOW OUT AND CAUSE SERIOUS INJURY. (Note: Tighten the nut until it is snug. When the vessel is pressurized, the pressure on the cover will complete the seal.)**

**THE USE OF CHEMICALS OTHER THAN PIRATE BRAND DESICCANT WILL VOID THE WARRANTY ON THE ADPB.**

A ADPB is a skid mounted system consisting of an air-cooled trim cooler, a single tower dryer with a bed of desiccant tablets and a coarse afterfilter. Wet warm air enters the trim cooler where it is cooled to a temperature approaching ambient. Water is condensed out during this cooling process. The saturated air and the liquid water proceed to the inlet of the single tower dryer. The liquid water and any solid particles present are separated by gravity and fall to the dryer sump area. The process air moves upward through the bed of desiccant tablets which attract and absorb moisture from the air before it flows through the dryer outlet. The tablets dissolve gradually as they absorb the moisture. The solution, which consists of dissolved desiccant and water, falls into the sump area at the bottom of the vessel. The dryer must be drained periodically to remove the accumulated solution. A manual ball valve is supplied for this purpose. A pneumatic drain valve is available as optional equipment for automatic draining. Likewise, the desiccant in the dryer must be periodically replenished to maintain performance. The coarse afterfilter is supplied to catch any residuals that may work their way downstream.

## SECTION 2

## PERFORMANCE

## 2.1 INLET CONDITIONS

The ADPB are rated as follows: 400 SCFM (ADPB-400), 750 through 950 SCFM (ADPB-750-950), 1200 SCFM (ADPB-1200) and 1600 SCFM (ADPB-1600) respectively at 100 PSIG, 180° F into the trim cooler (sized for 90° F ambient and 10° approach). Approach temperatures will vary with changes to the inlet conditions (flow, pressure, temperature) and the ambient temperature. The dew point out of the dryer tower is directly related to the inlet temperature entering the dryer vessel. The lower the inlet temperature, the lower the dew point of the outlet air.

The aftercooler maximum inlet temperature is 250° F. When using DRY-O-LITE desiccant, the inlet temperature to the dryer tower should not exceed 100° F.

2.2 MAXIMUM CAPACITIES FOR DRYER - SCFM (Nm<sup>3</sup>/hr)

MODEL	MAXIMUM RECOMMENDED WORKING PRESSURE	60 PSIG	80 PSIG	100 PSIG	125 PSIG	150 PSIG
		4.1 Bar	5.5 Bar	6.9 Bar	8.6 Bar	10.3 Bar
ADPB-400	150 PSIG 10.3 Bar	261	330	400	487	574
		419	531	643	783	923
ADPB-750-950	150 PSIG 10.3 Bar	521	661	800	974	1149
		838	1062	1286	1567	1847
ADPB-1200	150 PSIG 10.3 Bar	782	991	1200	1462	1723
		1256	1593	1929	2350	2770
ADPB-1600	150 PSIG 10.3 Bar	1042	1321	1600	1949	2297
		1675	2124	2572	3133	3694

## SECTION 3

## OPTIONS

## 3.1 PRESSURE RELIEF VALVE

A 2" NPT coupling is provided on the back of the dryer vessel for installing the relief valve. A pressure relief valve should be installed to conform to OSHA safety standards. Refer to OSHA Standard Section 1910.169, paragraph "b", subparagraph "3" and any other federal, state or local codes concerning pressure vessels.

See section 6 for recommended relief valves (available from your Pirate Brand rep.)

## 3.2 PNEUMATIC DRAIN VALVE (P/N 39-0284)

The 1"NPT drain connection can be fitted with a PDV-500T pneumatic drain valve for automatic draining of the vessel. Ask your local Pirate Brand representative for details.

## 3.3 GAUGE KITS

A 1/2" NPT coupling is provided on the lower front of the dryer for installing gauges.

See Section 6 for optional gauge kits (available from your Pirate Brand rep.)

## 3.4 HIGH LEVEL ALARM (P/N 26-3667)

A 3/4"NPT connection is provided, on the ADPB-750-950 through ADPB-1600, for installing a HLA-120 High Level Alarm to alert personnel that the drain solution in the dryer has reached an unacceptable level. Ask your local Pirate Brand representative for details.

## SECTION 4

## OPERATION

## 4.1 DESICCANT INSTALLATION

**IMPORTANT**

The Air Dryer is shipped **WITHOUT** the desiccant installed. The desiccant **MUST BE INSTALLED** before using the system.

**THE USE OF CHEMICALS OTHER THAN PIRATE BRAND DRY-O-LITE WILL VOID THE WARRANTY ON THE DRYER.**

The procedure for filling the dryer with desiccant is outlined in Section 5.6 of this manual.

MODEL	LUBRICATOR OIL DROPS PER MINUTE
ADPB-400	1
ADPB-750-950	1
ADPB-1200	1
ADPB-1600	2

## 4.2 LUBRICATOR OIL

Check oil level in lubricator regularly and add oil as required.

**IMPORTANT**

The Air Dryer is shipped **WITHOUT** the lubricator oil installed. The lubricator oil **MUST BE INSTALLED** before using the system.

## 4.3 START UP PROCEDURES

**SLOWLY** pressurize the air system. Allow some air to bleed through the manual drain valve. Once the system starts to pressurize, the manual drain valve can be closed. The Air Dryer is now in operation.

**CAUTION**

Make sure that the Air Dryer is not subjected to sudden flow surges. Always open the valves slowly to permit gradual equalization of pressure between the Air Dryer and the air supply lines.

Verify that regulator pressure is set as shown on page 1 of this manual to maintain 1725 rpm fan speed to ensure proper aftercooler performance.

#### 4.4 OPERATION

The simple design of the single tower dryer allows for easy operation. The dryer requires two procedures to ensure peak performance.

##### 4.4-A DAILY DRAINING

The accumulated desiccant and water solution in the bottom of the dryer should be drained frequently. If a manual drain valve is installed on the dryer, it must be opened at least once every 4 to 8 hours to drain the dryer.

The dryer may require draining on a more frequent basis on humid days. If a pneumatic drain valve is installed on the dryer, it will drain automatically as needed.

#### CAUTION

**If the dryer is not drained regularly, it may become flooded and the accumulated liquid may enter the air system and cause damage to downstream equipment.**

#### 4.4-B REFILLING THE DRYER WITH DESICCANT

During the drying process, the desiccant tablets dissolve slowly. The desiccant consumption rate is dependent on several factors, such as inlet temperature, flow and pressure. To check the level of the desiccant bed, look into one of the sight windows. If light can be seen through the opposite sight window, the desiccant supply must be replenished to ensure dryer performance.

Reference Section 5 for refilling instructions and estimated consumption rates.

#### IMPORTANT

**The use of other than Pirate Brand Dry-O-Lite will void the warranty on the Air Dryer.**

#### 5.1 DRAIN VESSEL DAILY

Drain the vessel by opening the drain valve and allowing the solution to discharge; then close the drain valve completely. The accumulated solution must be drained after every 4 to 8 hours of operation. An optional pneumatic drain valve can be installed to drain the vessel automatically as needed.

#### IMPORTANT

**The drain solution may contain lubricants. Comply with all applicable regulations concerning the disposal of these chemicals.**

#### 5.2 CHECK DESICCANT LEVEL BEFORE OPERATION

Look into one of the sight windows. If light can be seen through the opposite sight window, the desiccant supply must be replenished to ensure dryer performance.

#### WARNING

**IF THE SIGHT WINDOWS ARE DAMAGED IN ANY WAY, THEY MUST BE REPLACED IMMEDIATELY WITH PIRATE BRAND PART NO. 26-0104 only.**

Check the operation of all equipment installed before and after the Air Dryer.

Inspect the hatch cover for signs of corrosion and/or leaks. Replace the cover and/or gasket as necessary.

#### 5.3 CHECK OIL LEVEL IN LUBRICATOR

Verify that there is sufficient amount of oil in the lubricator and add oil as needed. See section 6 for oil part number.

#### 5.4 CHECK FILTER IN FRL

Replace filter as needed. See section 6 for filter part number.

#### 5.5 CLEAN AFTERCOOLER CORE

The core should be cleaned regularly. Accumulation of dirt or other contaminants such as oils will greatly reduce the efficiency of the aftercooler.

Normal accumulation of dirt can be removed by blowing the core off with compressed air. If the core becomes contaminated with oil-laden particles, it can be steam cleaned. **Clean with extreme care as the aluminum fins can be easily damaged.**

#### 5.6 ADDING DESICCANT

Shut down the air system and open the drain valve to allow the dryer to depressurize completely.

Loosen the nut on the hatch cover.

Push on the hatch cover. If the vessel is depressurized, the cover will unseal. Once the seal is broken, tilt the hatch cover and remove it from the dryer.

Add the amount of desiccant tablets required to raise the supply to the maximum operating level; then level off the tablet bed.

Amount of desiccant required to fill from sight window to maximum fill level:

MODEL	DRY-O-LITE
ADPB-400	150lb.
ADPB-750-950	250 lb.
ADPB-1200	250 lb.
ADPB-1600	400 lb.

#### CAUTION

**Make sure the desiccant level is below the screen on the outlet pipe.**

**Do NOT overfill the vessel. Adequate space must be left to allow the hatch cover to be installed.**

Inspect the hatch cover and sealing surface. If there is any damage, replace the cover. Replace the cover every 5 years regardless of condition. The gasket should be replaced every time the hatch cover is removed or at least once a year.

Check the sealing surface of the opening. If it is contaminated with dirt or rust, it must be cleaned before installing the hatch cover. A contaminated surface may prevent the gasket from properly sealing.

Install the filler hatch cover and a new gasket. Tighten the nut on the hatch cover until it is snug. Overtightening will cause damage to the nut. The cover will seal when the vessel is pressurized.

Start up the dryer following the procedures in Section 4.3.

#### 5.7 ESTIMATING DESICCANT USAGE

The ANNUAL DESICCANT CONSUMPTION RATE table is a guide to estimate the desiccant usage for your installation.

**The consumption rate is an approximation of how much desiccant will be added over a period of one year.**

The figure is an average and may vary depending upon your actual conditions (i.e. 24 hour operation, higher inlet temperature, excessive liquid water content, contaminants etc.)

The desiccant bed level should be maintained to at least the sight window level at all times to ensure optimum drying capabilities.

To use the chart, first determine the SCFM that is being processed through the Air Dryer. Then locate the nearest flow rate listed on the chart and interpolate as needed.

(This chart is based on 1 shift for a one year period (2,000 hours)@ 100 psig inlet pressure and 75°F inlet temperature into dryer vessel, 100% RH.)

The consumption rate is proportional to the moisture loading. Each 20°F increase in inlet temperature changes the moisture loading by a factor of nearly 2:1.

FLOW SCFM	DRY-O-LITE LBS/YEAR
200	264
400	528
600	792
800	1056
1000	1320
1200	1584
1400	1848
1600	2112

DESCRIPTION	PART NO.	ADPB-400 QTY	ADPB-750-950 QTY	ADPB-1200 QTY	ADPB-1600 QTY
Gasket for 4"x6" hatch cover	18-0394	1	1	1	1
Hatch Cover, 4" x 6"	46-3003	1	1	1	1
Sight Window	26-0104	2	2	2	2
Manual Drain Valve 1" NPT	14-0451	1	1	1	1
Manual Drain Valve 1/2" NPT	14-0450	1	1	1	1
Air Motor for Aftercooler	26-6277	1	-	-	-
Air Motor for Aftercooler	34-0926	-	1	1	-
Air Motor for Aftercooler	34-0925	-	-	-	1
Filter-Regulator-Lubricator	26-7039	1	-	-	-
Filter-Regulator-Lubricator	26-7009	-	1	1	-
Filter-Regulator-Lubricator	26-6836	-	-	-	1
Element for FRL	26-7056	1	-	-	-
Element for FRL	26-7027	-	1	1	-
Element for FRL	26-7030	-	-	-	1
Oil for Lubricator (Quart)	26-7032	1	1	1	1
<b>DESICCANT</b>					
DRY-O-LITE Desiccant, 50 LB BAG	FD2-100	8	10	15	20
<b>OPTIONAL EQUIPMENT</b>					
Relief Valve Kit for ADPB 400-1600	888-2470-00703PB	1	1	1	1
Pressure gauge kit	29-0252	1	1	1	1
Pressure gauge only	29-0151	1	1	1	1
Temperature gauge kit	29-0326	1	1	1	1
Temperature gauge only	29-0108	1	1	1	1
Thermowell only	29-0107	1	1	1	1
Combination pressure/temperature gauge	29-0200	1	1	1	1
HLA-120 High level alarm kit	26-3667	-	1	1	1
Automatic drain valve PDV-500T	39-0284	1	1	1	1
White touch up paint (9 oz. spray can)	45-0152	1	1	1	1

2719 Tobey Dr.  
Indianapolis, IN 46219  
Phone: (800) 892-6223



WWW.PIRATE-BRAND.COM